


Figure 5  
CHRISTALCREEK  
MASS LOADING NODE INPUTS  
SCHEMATIC

Dashed lines indicate discharge to ground  
Solid lines indicate discharge to waterways

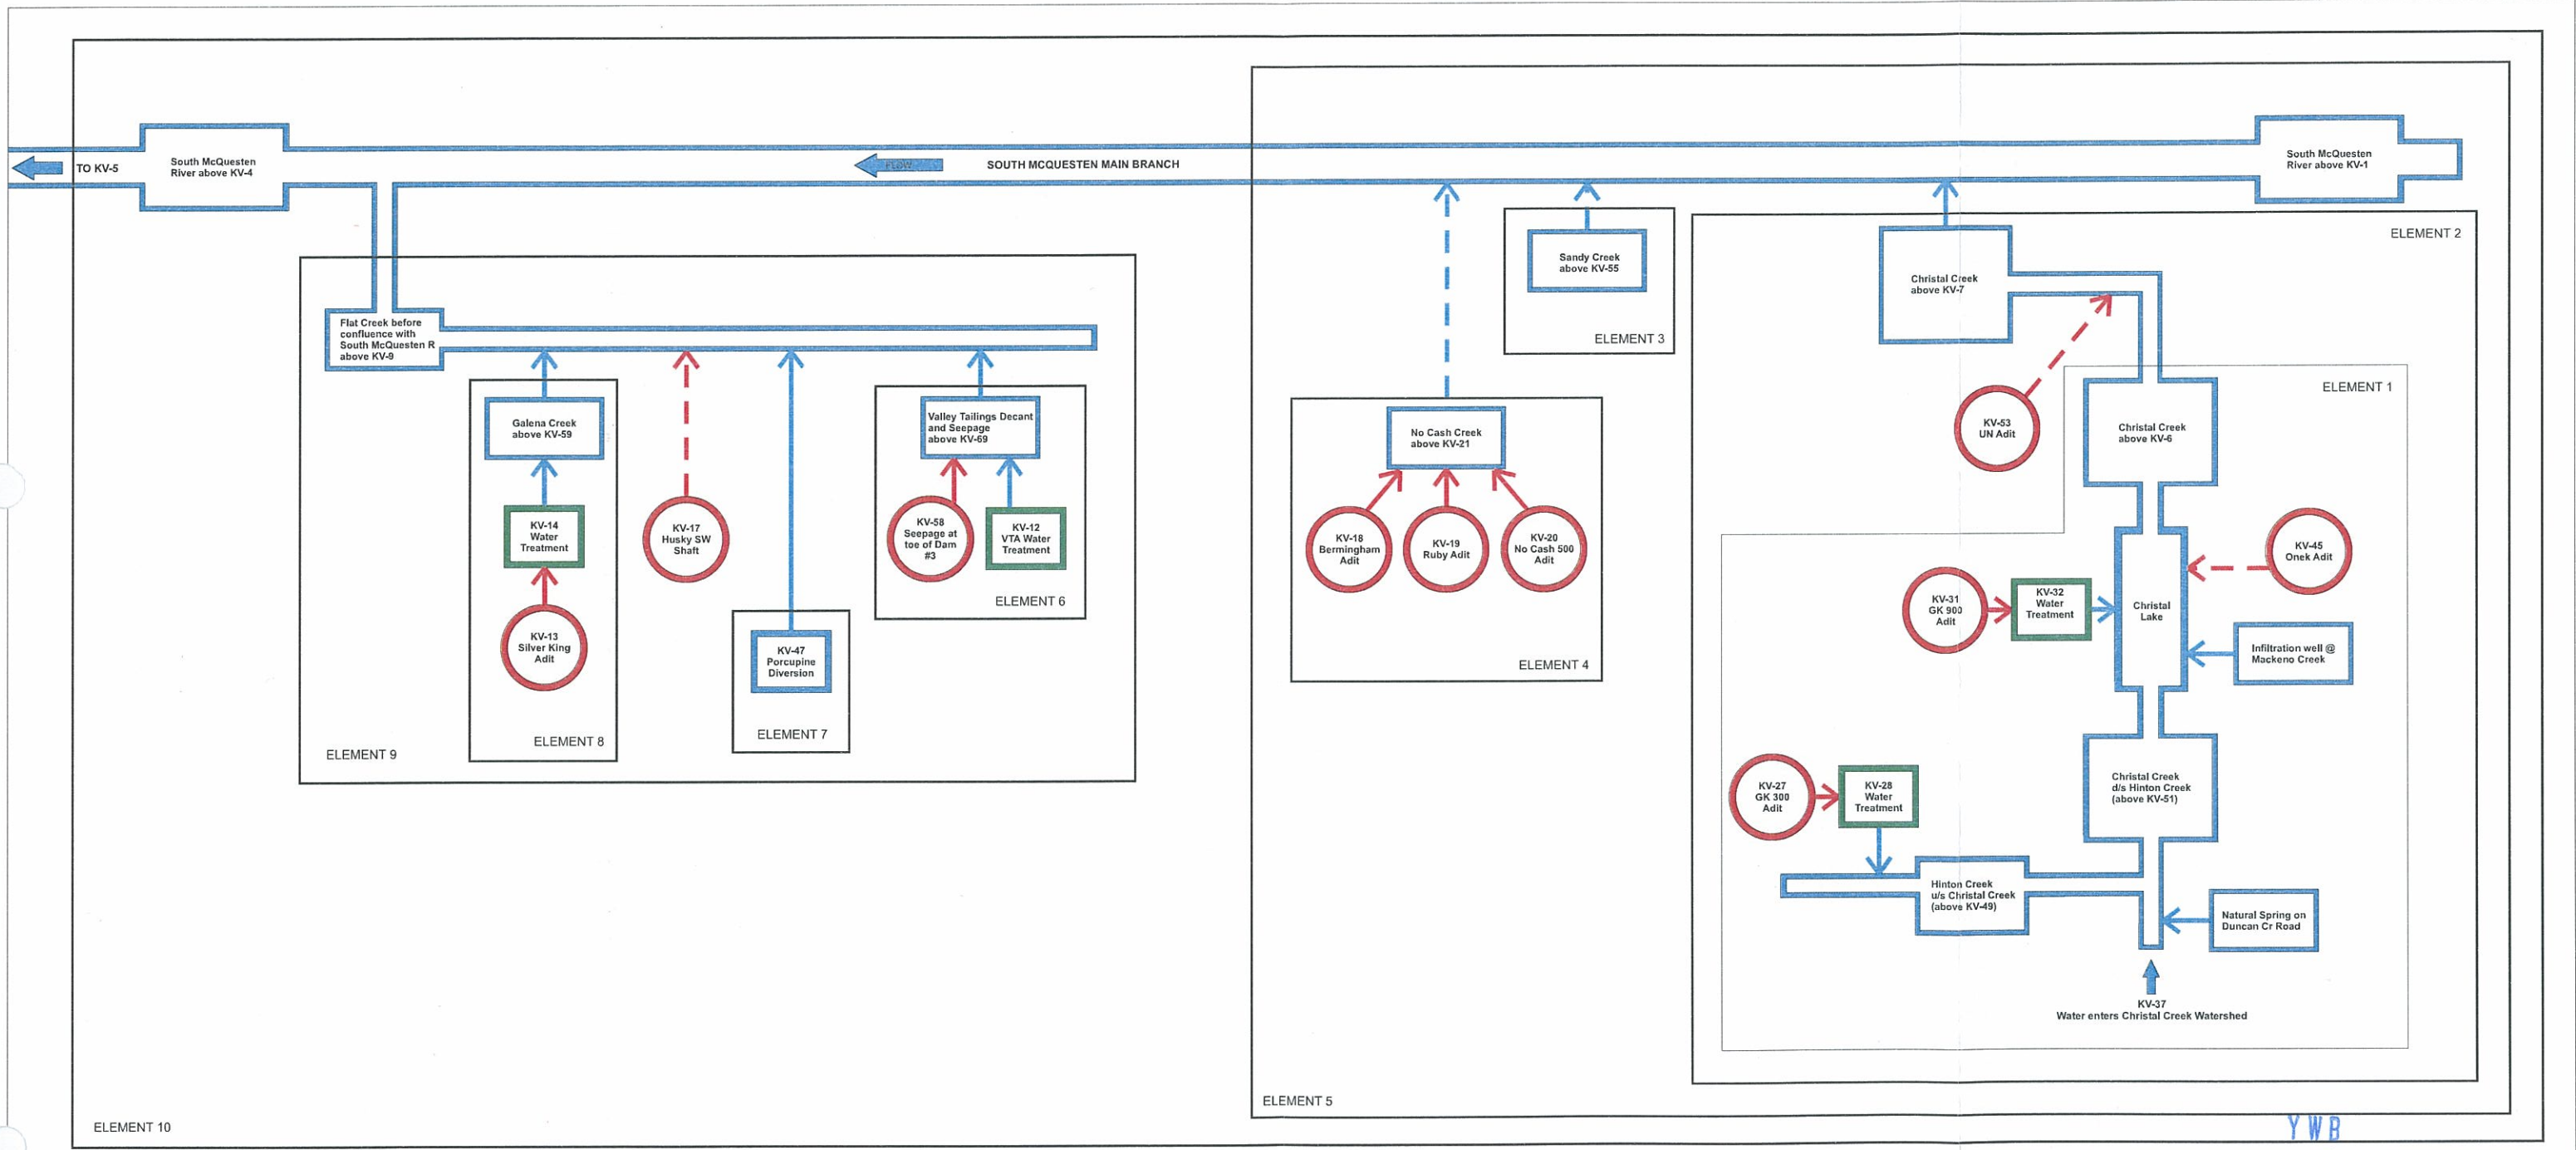

ELEMENT 11 (to KV-5; only input is incremental catchment between KV-4 and KV-5)

YWB  
-01-19 2010  
0709 092